



Maxi Tank AR or CR Tank Installation - Overview.

- Order Aquamate Maxi Tank AR or CR Tank - Receive and review order confirmation.
- Prepare tank pad for your Aquamate Maxi Tank AR or CR Tank - see details below.
- Inform Aquamate you are ready for your Aquamate Maxi Tank AR or CR Tank to be installed - text or email the completed tank pad image to Aquamate: installations@aquamate.com.au or text 0490 023 477
- You will be allocated the next available installation date. (Note this date is tentative as weather can delay our installers)
- We will contact you one to two weeks prior to installation to provide details regarding your tank installation.
- Meet the installers on site, to confirm the tank positioning and fitting locations.
- Provide enough water to secure the tank and liner. This must be done prior to the installer leaving site. A minimum depth of 150 mm is sufficient in all but extreme conditions. If you cannot get water into the tank from what you have on site, you may need to order a water delivery via tanker.

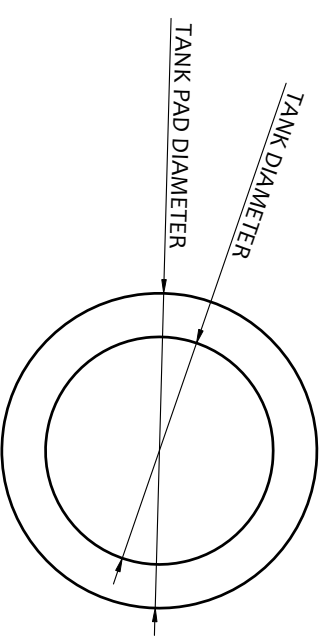

TANK PAD PLAN

TANK PAD DIAMETER = TANK DIAMETER + 2 m
SEE TABLE BELOW

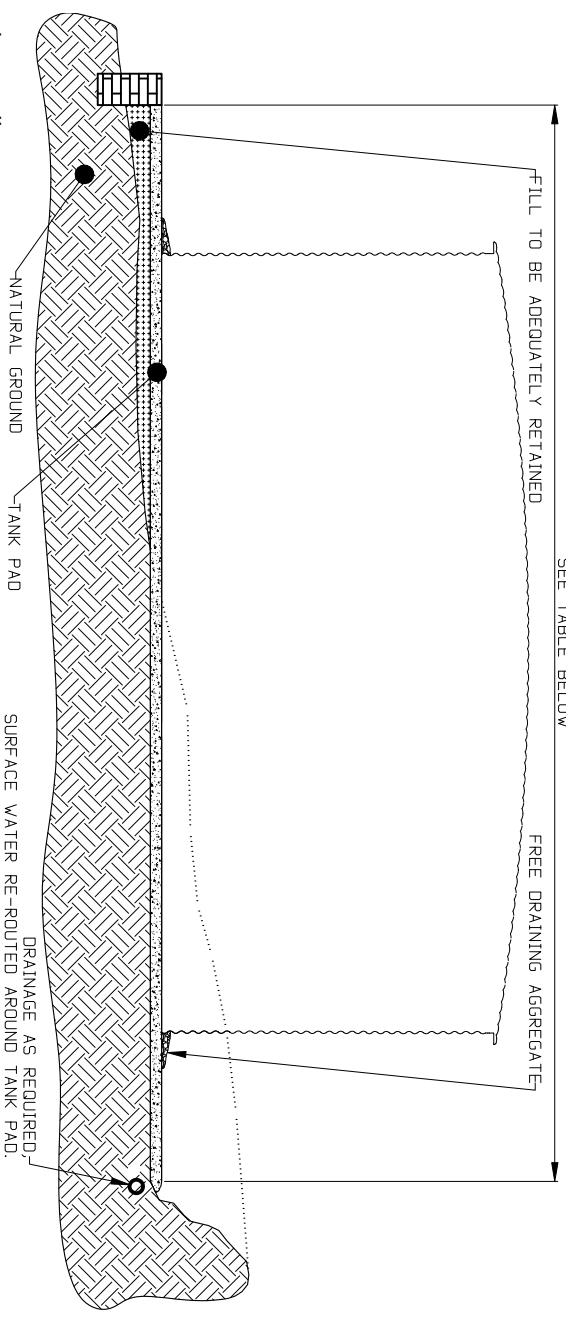

TANK ELEVATION SCHEMATIC

SUITABILITY - This guide is applicable for Aquamate Maxi Tank AR or CR Tank 2.2m and 2.9m tall

WARRANTY - Aquamate warranty is subject to site preparation as per these instructions.

AQUAMATE MAXI TANK AR or CR TANK : PAD & WATER DETAILS

AQUAMATE MAXI TANK AR or CR TANK : PAD & WATER DETAILS																
TANK MODEL	D033	D039	D046	D052	D059	D065	D072	D078	D085	D091	D098	D104	D111	D117	D124	D130
PAD DIAMETER (m)	5.3m	5.9m	6.6m	7.2m	7.9m	8.5m	9.2m	9.8m	10.5m	11.1m	11.8m	12.4m	13.1m	13.7m	14.4m	15m
MINIMUM WATER QUANTITY (litres needed on the day)	1,500 L	2,000 L	2,500 L	3,500 L	4,500 L	5000 L	6,000 L	7,500 L	8,500 L	10,000 L	11,500 L	13,000 L	14,500 L	16,500 L	18,000 L	20,000 L

REVISION TABLE					 DRURY TCE TONLSEY SA 5042 08 8277 5777						
B	DEPTH WAS 100, TITLE CHANGE, ADD TANK SIZES	24/6/26	JC	DD		ALL DIMENSIONS IN mm UNLESS OTHERWISE STATED	DESCRIPTION				
A	ISSUE FOR INFORMATION	14/3/23	JC	DD			AQUAMATE WATER TANKS MAXI TANK AR or CR TANK RANGE SITE PREPARATION DETAILS - WITH GEOMAT				
REV	DESCRIPTION	DATE	BY	CHECKED			PROJ No.	DWG No.	REV		
							INSTALLATIONS	ANI-RX-5500-001	B		

Details -

- The tank pad diameter must be at least 2 m larger than the tank being installed.
- Remove all vegetation and sharp objects from the tank pad location.
- Wherever possible, the tank pad should be excavated into natural ground.
- When excavating a site, adequate drainage must be installed to allow water to be diverted around the tank pad.
- When using fill to level a site, adequate retaining must be installed to maintain pad integrity.
- Tank pad material must be crushed stone with particle size 6mm or less
- Tank pad base to be approximately 75mm thick
- Tank pad to be flat and level to within +/- 10mm
- Once complete, ensure any damage by vehicles or livestock is adequately repaired.
- Once the tank installation is complete, place a layer of free draining aggregate around the perimeter of the tank to reduce base erosion.

SUITABILITY - This guide is applicable for Aquamate Maxi Tank AR or CR Tank 2.2m and 2.9m tall

WARRANTY - Aquamate warranty is subject to site preparation as per these instructions.

TANK ELEVATION SCHEMATIC

SUITABILITY - This guide is applicable for Aquamate Maxi Tank AR or CR Tank 2.2m and 2.9m tall

WARRANTY - Aquamate warranty is subject to site preparation as per these instructions.

AQUAMATE MAXI TANK AR or CR TANK : PAD & WATER DETAILS

AQUAMATE MAXI TANK AR or CR TANK : PAD & WATER DETAILS																
TANK MODEL	D033	D039	D046	D052	D059	D065	D072	D078	D085	D091	D098	D104	D111	D117	D124	D130
PAD DIAMETER (m)	5.3m	5.9m	6.6m	7.2m	7.9m	8.5m	9.2m	9.8m	10.5m	11.1m	11.8m	12.4m	13.1m	13.7m	14.4m	15m
MINIMUM WATER QUANTITY (litres needed on the day)	1,500 L	2,000 L	2,500 L	3,500 L	4,500 L	5000 L	6,000 L	7,500 L	8,500 L	10,000 L	11,500 L	13,000 L	14,500 L	16,500 L	18,000 L	20,000 L

REVISION TABLE					 DRURY TCE TONLSEY SA 5042 08 8277 5777						
B	DEPTH WAS 100, TITLE CHANGE, ADD TANK SIZES	24/6/26	JC	DD		ALL DIMENSIONS IN mm UNLESS OTHERWISE STATED	DESCRIPTION				
A	ISSUE FOR INFORMATION	14/3/23	JC	DD			AQUAMATE WATER TANKS MAXI TANK AR or CR TANK RANGE SITE PREPARATION DETAILS - WITH GEOMAT				
REV	DESCRIPTION	DATE	BY	CHECKED			PROJ No.	DWG No.	REV		
							INSTALLATIONS	ANI-RX-5500-001	B		